

Report No.: 1

Test Time: 2018/8/22 17:29

Luminaire Property

Luminaire Manufacturer: ASD Lighting Corp
Voltage: 120.5 V
Power: 101.70 W

Current: 0.850 A
Power Factor: 0.993


Photometric Results

CIE Class: Semi-Direct
Measurement Flux: 12331.2 lm
Downward Ratio: 61%
Horizontal Diffuse Angle(50%): H263.5
Vertical Diffuse Angle(50%): V262.6
Luminaire Efficacy Rating (LER): 121.30
Max. Intensity: 1461.08 cd
S/MH(C0/C180): 1.83


Total Rated Lamp Lumens: 12331.2 lm
Efficiency: 100%
Upward Ratio: 39%

Central Intensity: 1139.38 cd
Pos of Max. Intensity: H0 V41
S/MH(C90/C270): 1.83

Picture Of Luminaire



Luminous Intensity Distribution Curve

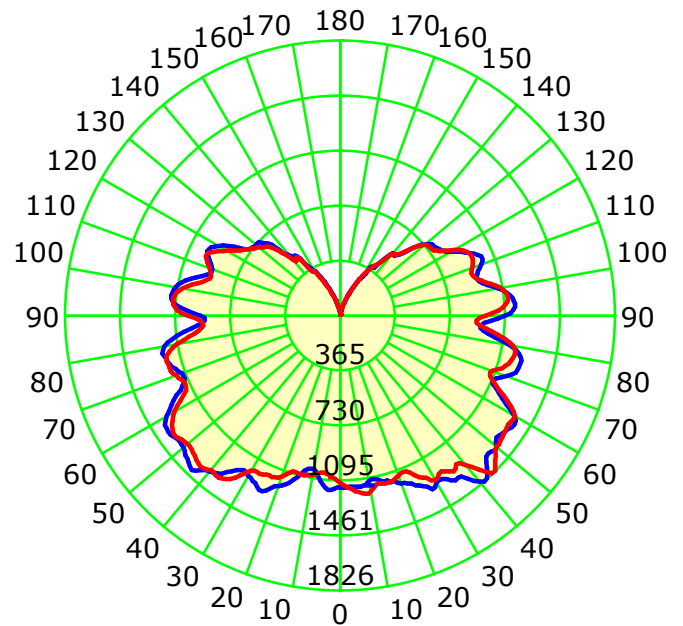

Unit: cd



Average Diffuse Angle(50%): 260.4°

— C0-C180 — C90-C270

C Plane (°):0.0-360.0: 45.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-180.0:1.0
Test Device: GPM-1800B
Distance: 10.160 m
Humidity:
Inspector:

Luminous Intensity Distribution Curve

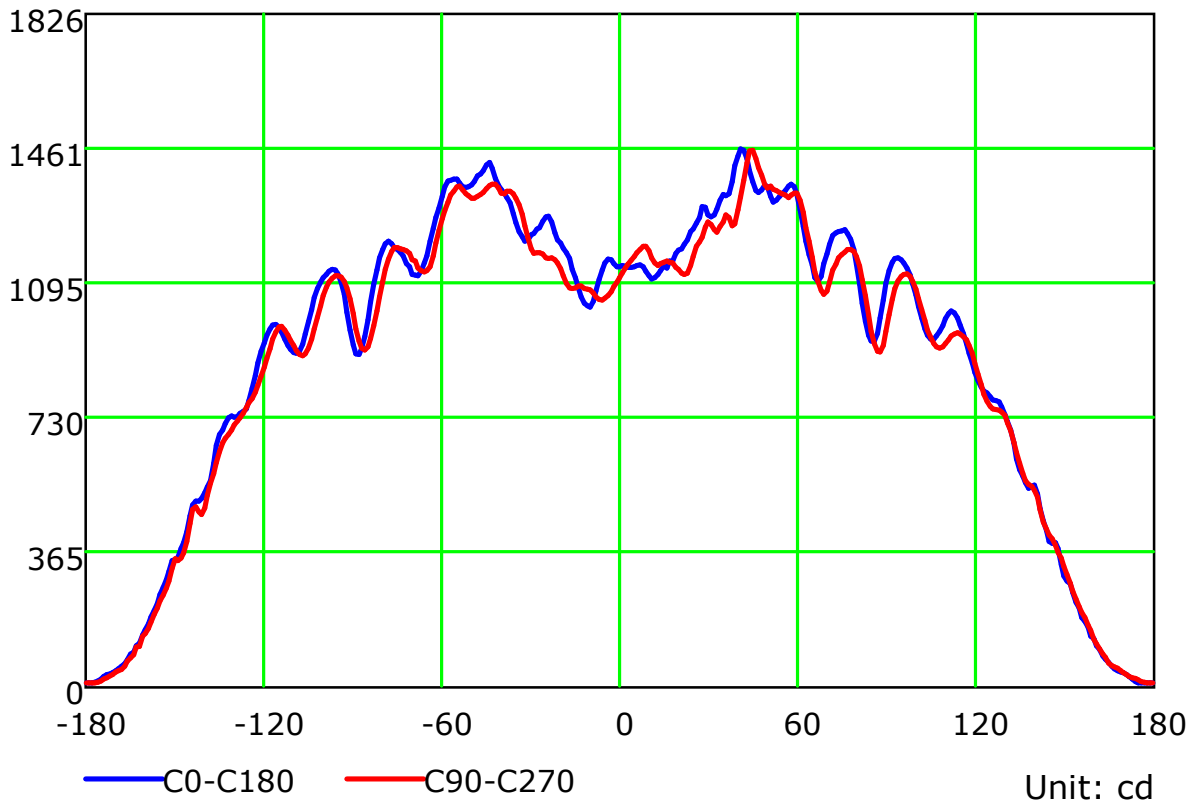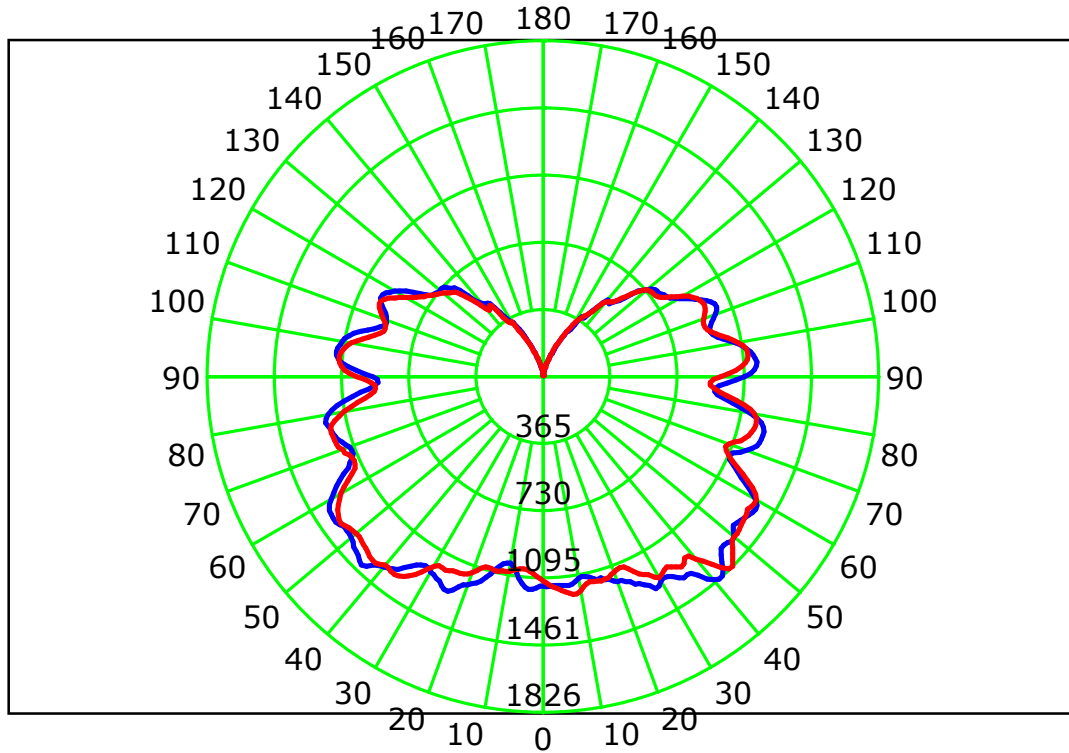


C Plane (°):0.0-360.0: 45.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-180.0:1.0
Test Device: GPM-1800B
Distance: 10.160 m
Humidity:
Inspector:

Coefficients Of Utilization - Zonal Cavity Method

RC	0.8	0.8	0.8	0.8	0.7	0.7	0.7	0.7	0.5	0.5	0.5	0.3	0.3	0.3	0.1	0.1	0.1	0
RW	0.7	0.5	0.3	0.1	0.7	0.5	0.3	0.1	0.5	0.3	0.1	0.5	0.3	0.1	0.5	0.3	0.1	0
RCR	RF = 0.2																	
0	110	110	110	110	103	103	103	103	90	90	90	78	78	78	67	67	67	61
1	96	89	84	79	89	83	78	74	72	68	64	61	58	56	52	49	47	42
2	85	76	67	61	79	70	63	57	60	55	50	51	47	43	43	39	36	32
3	77	65	56	48	71	60	52	45	52	45	40	44	39	34	36	32	29	25
4	70	57	47	40	64	53	44	37	45	38	33	38	33	28	32	27	24	20
5	63	50	40	33	59	46	38	31	40	33	27	34	28	23	28	23	20	17
6	58	44	35	28	54	41	33	26	35	28	23	30	24	20	25	20	17	14
7	54	40	30	24	49	37	29	23	32	25	20	27	21	17	23	18	15	12
8	50	36	27	21	46	33	25	20	29	22	17	25	19	15	21	16	13	10
9	46	32	24	18	43	30	23	17	26	20	15	23	17	13	19	14	11	9
10	43	30	22	16	40	28	20	15	24	18	14	21	15	12	17	13	10	8


Spacing Criteria (0-180): 1.83
 Spacing Criteria (90-270): 1.83
 Spacing Criteria (Diagonal): 1.90

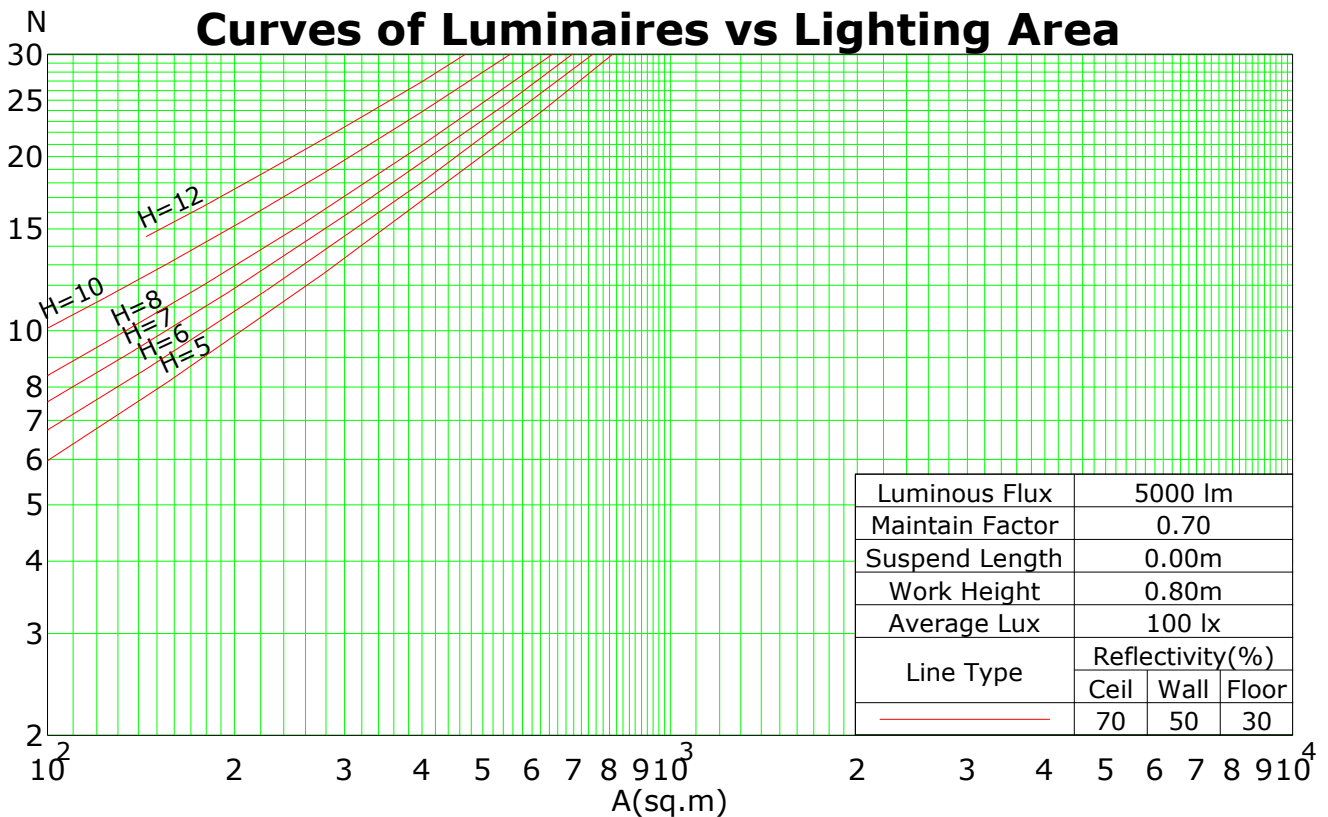

C Plane (°):0.0-360.0: 45.0
 Test Lab:
 Test Type: TYPE C
 Temperature:
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: GPM-1800B
 Distance: 10.160 m
 Humidity:
 Inspector:

IsoLux Plot

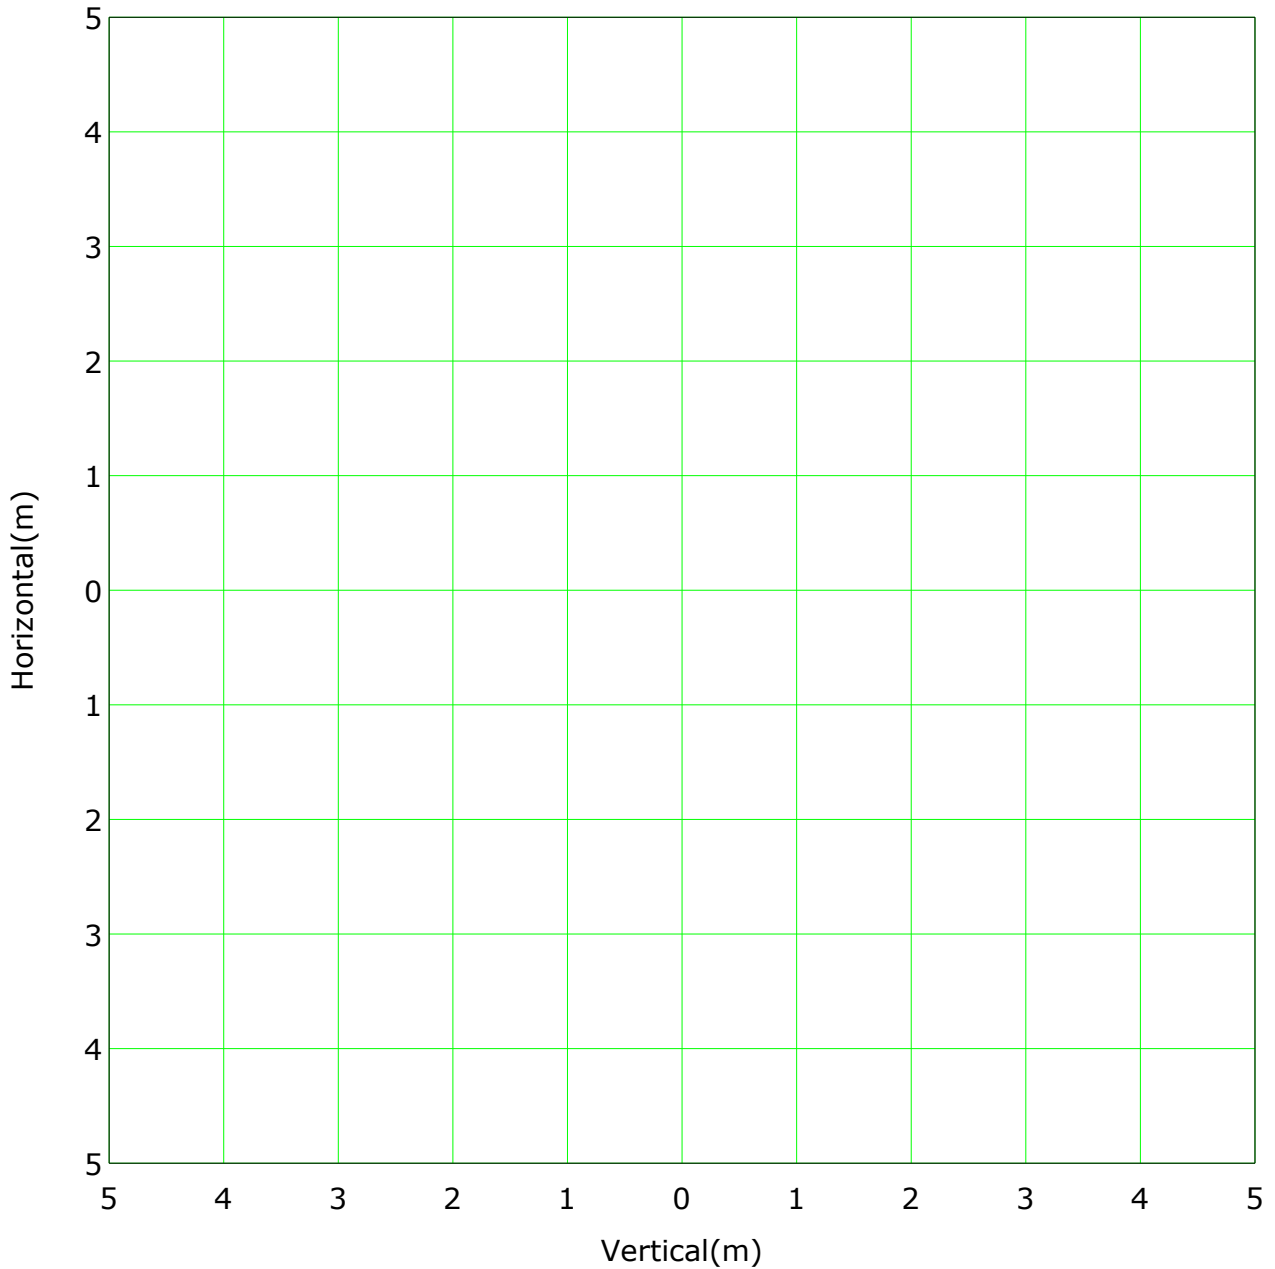

Mounting Height: 10.0m		Max Lux(100%): 11.6 lx
<ul style="list-style-type: none"> — (1%): 0.1 lx — (5%): 0.6 lx — (20%): 2.3 lx — (100%): 11.6 lx 	<ul style="list-style-type: none"> — (2%): 0.2 lx — (10%): 1.2 lx — (50%): 5.8 lx 	



C Plane (°):0.0-360.0: 45.0
 Test Lab:
 Test Type: TYPE C
 Temperature:
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: GPM-1800B
 Distance: 10.160 m
 Humidity:
 Inspector:

Lum Limit Curve

Dazzle	Quality	Illuminance (lx)							
		2000	1000	500	<=300				
1.15	A	2000	1000	500	<=300				
1.50	B		2000	1000	500	<=300			
1.85	C			2000	1000	500	<=300		
2.20	D				2000	1000	500	<=300	
2.55	E					2000	1000	500	<=300

a b c d e f g h

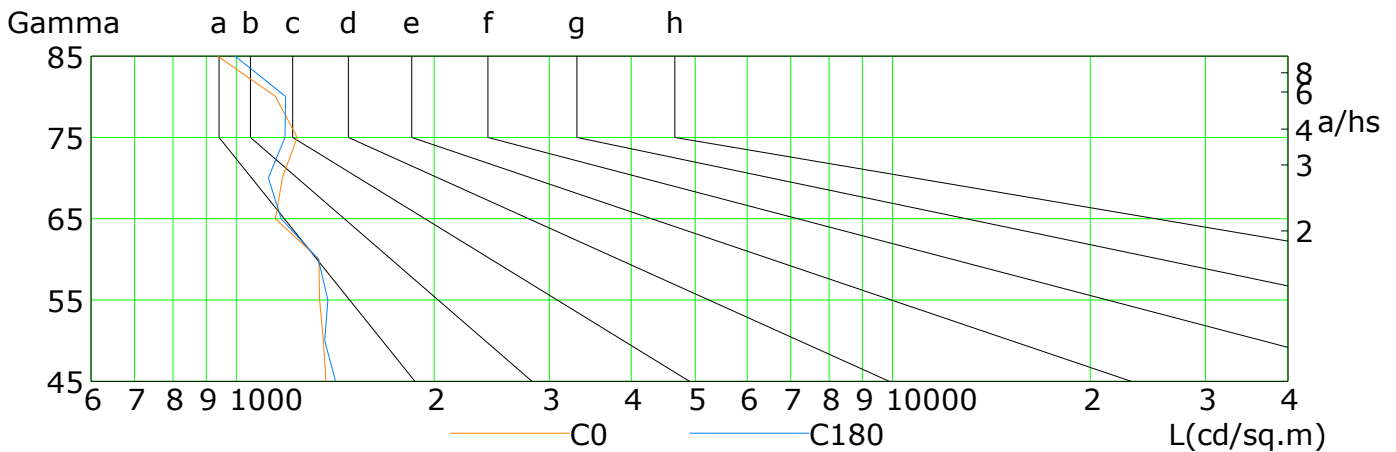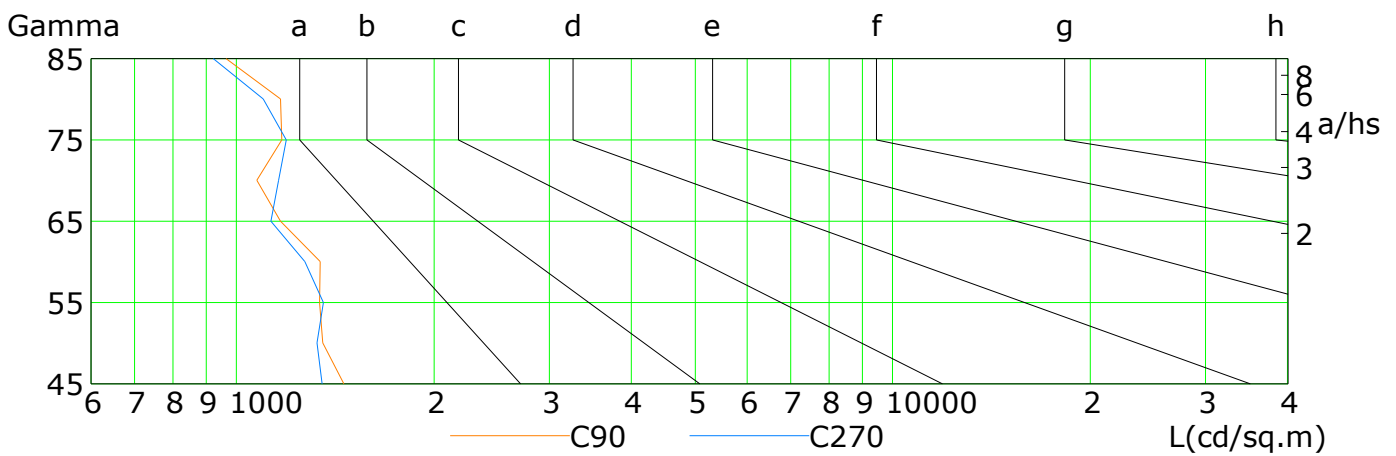


L(cd/sq.m)	G45	G50	G55	G60	G65	G70	G75	G80	G85
C0	1371	1358	1338	1336	1146	1176	1238	1147	938
C90	1458	1353	1338	1341	1167	1075	1173	1168	964
C180	1416	1362	1378	1332	1170	1119	1188	1188	997
C270	1352	1327	1358	1271	1130	1160	1192	1100	923

C Plane (°):0.0-360.0: 45.0
 Test Lab:
 Test Type: TYPE C
 Temperature:
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: GPM-1800B
 Distance: 10.160 m
 Humidity:
 Inspector:


Illuminance at a Distance

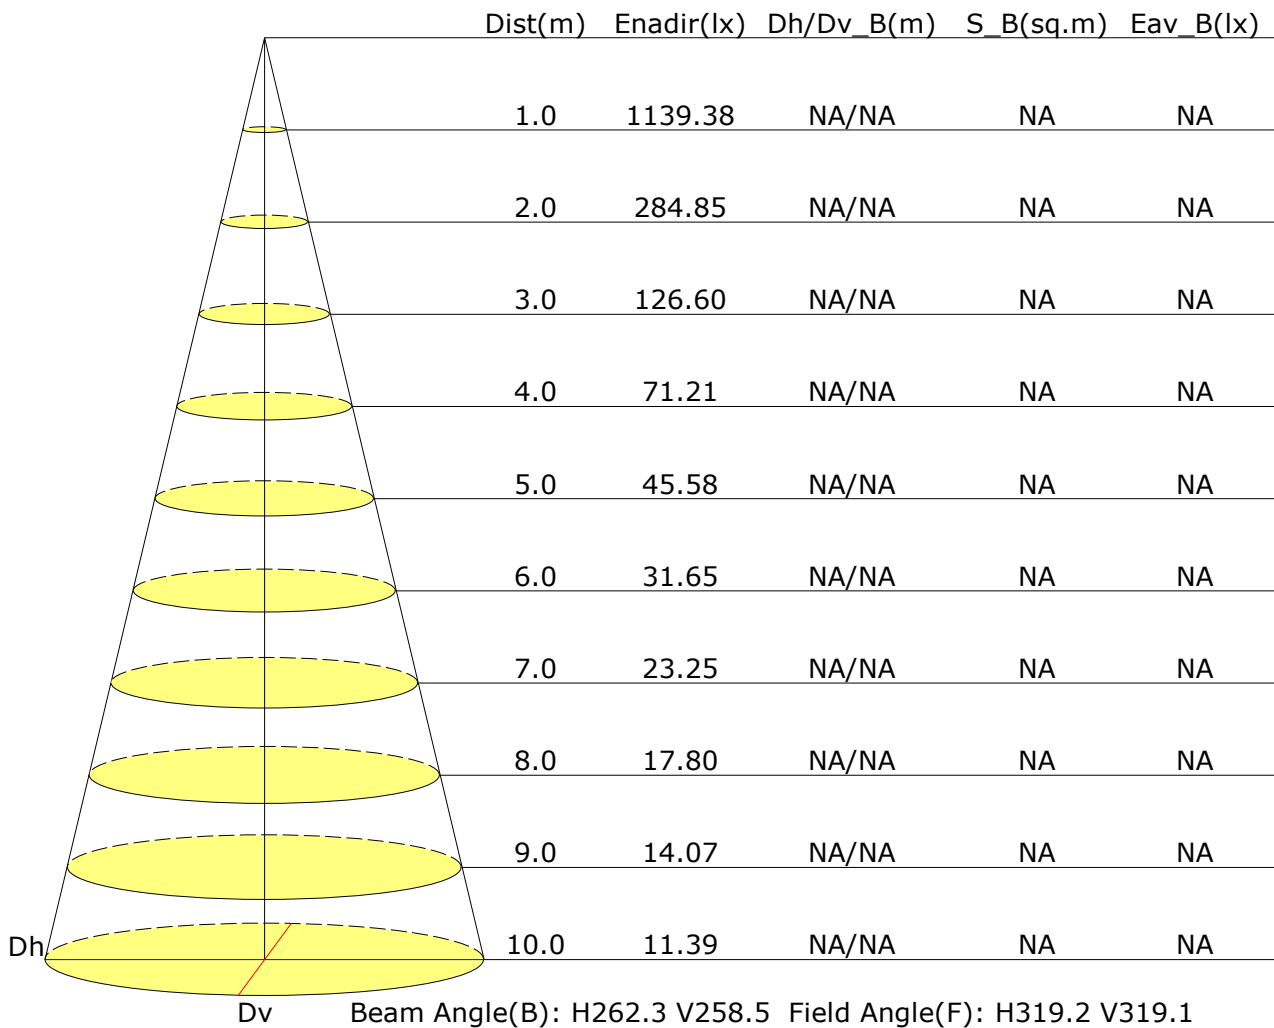

C Plane (°):0.0-360.0: 45.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-180.0:1.0
Test Device: GPM-1800B
Distance: 10.160 m
Humidity:
Inspector:

Vertical IsoLux Plot

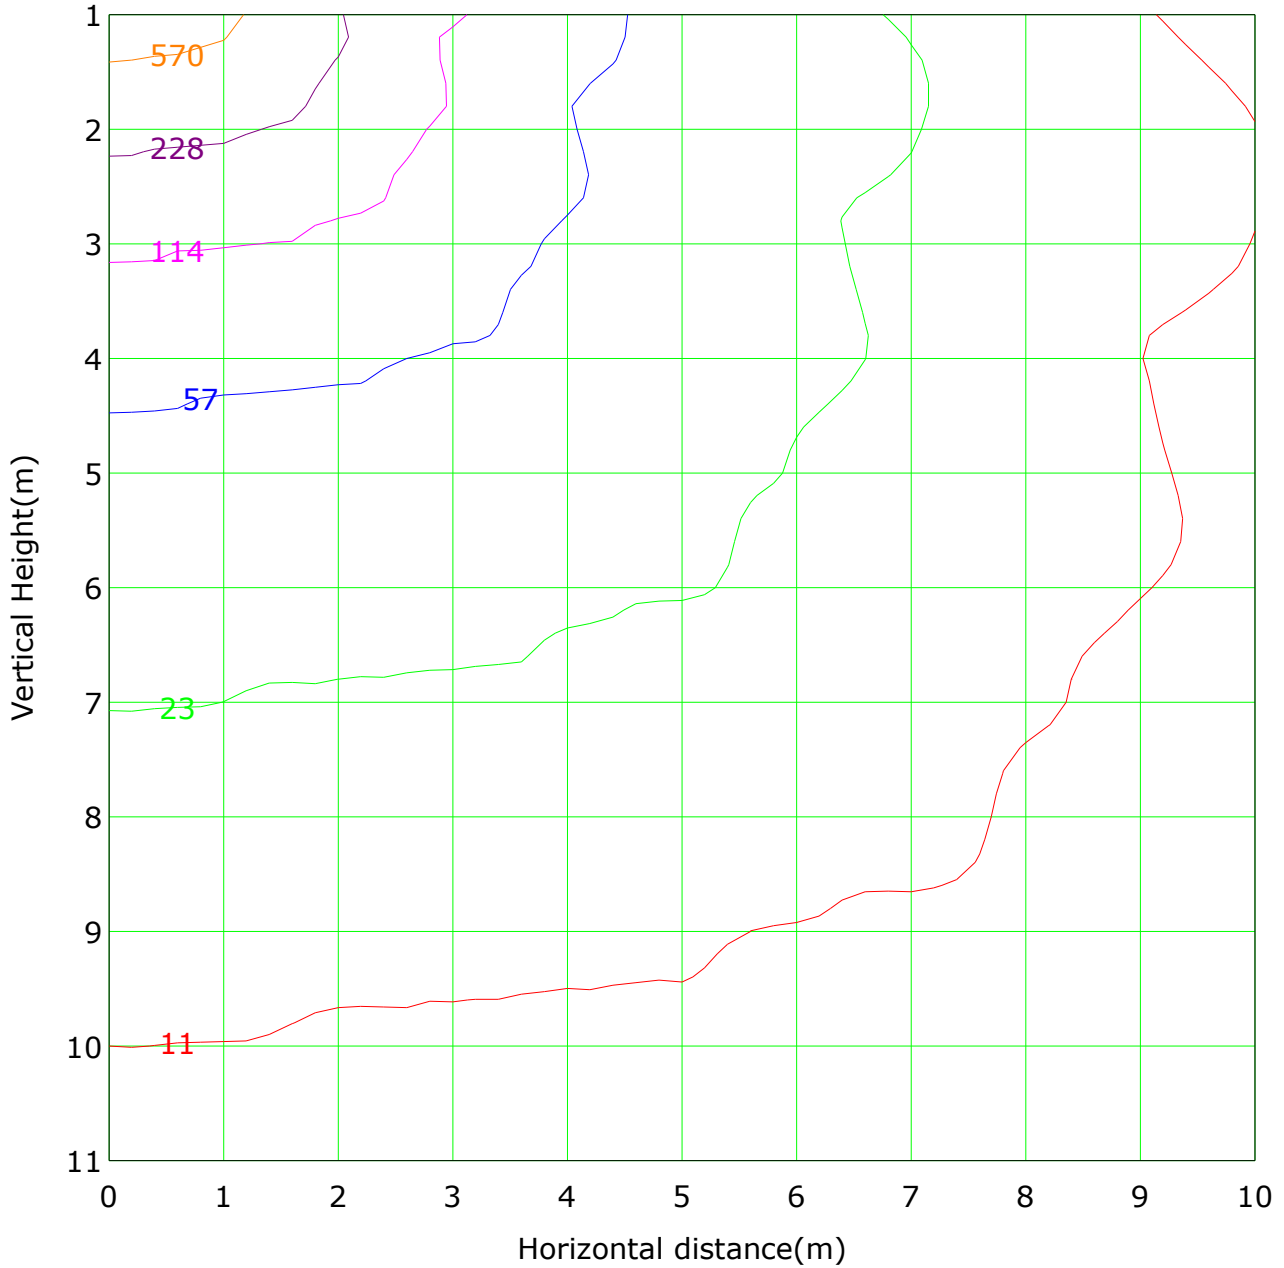


Lowest(m): 1.0m	Highest(m): 11.0m	Max Lux: 1139.4 lx
— (1%): 11.4 lx	— (2%): 22.8 lx	
— (5%): 57.0 lx	— (10%): 113.9 lx	
— (20%): 227.9 lx	— (50%): 569.7 lx	
— (100%):1139.4 lx		

C Plane (°):0.0-360.0: 45.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-180.0:1.0
Test Device: GPM-1800B
Distance: 10.160 m
Humidity:
Inspector:

The Average Illuminance Effective Figure

Flux Out: 11511.65lm

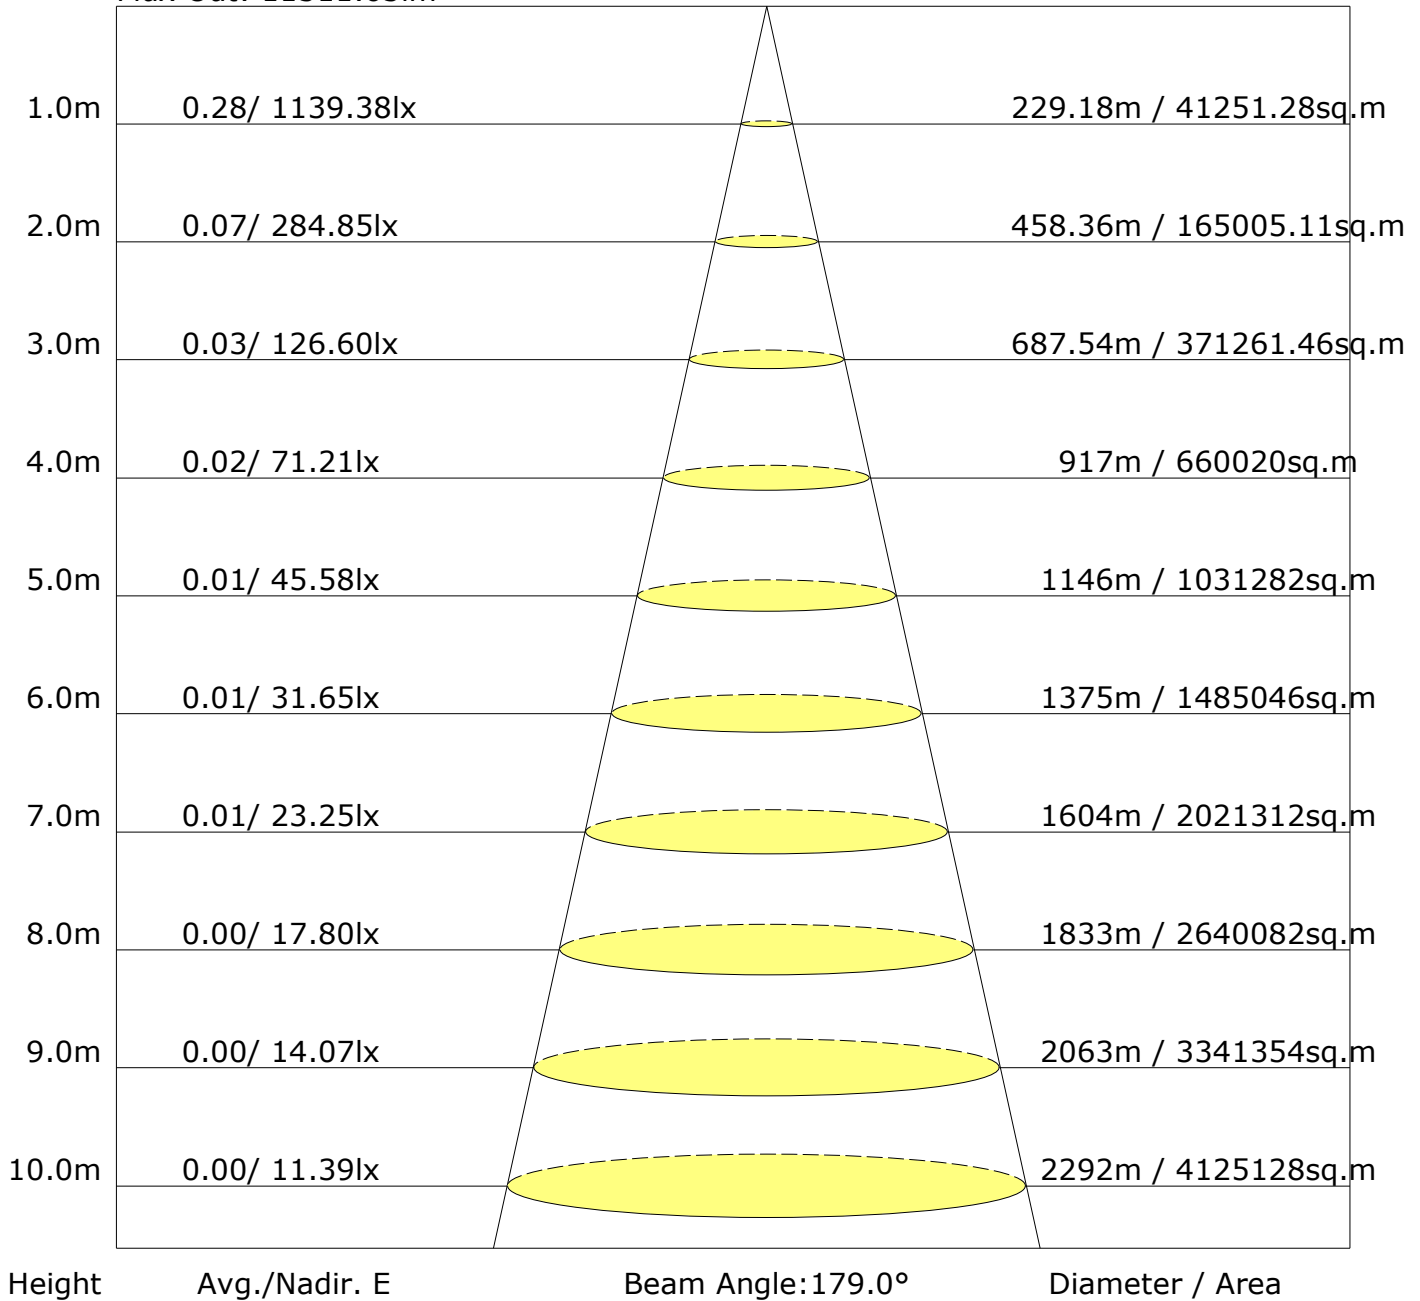

C Plane (°):0.0-360.0: 45.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-180.0:1.0
Test Device: GPM-1800B
Distance: 10.160 m
Humidity:
Inspector:

UGR Table

Reflectance:										
Ceiling (cavity)	0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall	0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions	Viewed crosswise					Viewed endwise				
X=2H Y=2H	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$
3H	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$
4H	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$
6H	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$
8H	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$
12H	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$
X=4H Y=2H	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$
3H	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$
4H	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$
6H	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$
8H	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$
12H	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$
X=8H Y=4H	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$
6H	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$
8H	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$
12H	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$
X=12H Y=4H	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$
6H	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$
8H	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$
Variations with the observer position at spacings:										
S=1.0H										
S=1.5H										
S=2.0H										

Calculate in accordance with CIE Pub.117. The table is revised with 12331lm ($8\log(F/F_0) = 8.7$).

C Plane (°):0.0-360.0: 45.0
 Test Lab:
 Test Type: TYPE C
 Temperature:
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: GPM-1800B
 Distance: 10.160 m
 Humidity:
 Inspector:

Zonal Lumen

Gamma [°]	I _{mean} [cd]	Zonal Flux [lm]	Sum Zonal Flux [lm]	Rel Zonal Flux [%]	Sum Rel Zonal Flux [%]
0.0-1.0	1118.9	1.1	1.1	0.01	0.01
1.0-2.0	1120.2	3.2	4.3	0.03	0.03
2.0-3.0	1121.4	5.4	9.7	0.04	0.08
3.0-4.0	1121.7	7.5	17.2	0.06	0.14
4.0-5.0	1121.2	9.6	26.8	0.08	0.22
5.0-6.0	1118.5	11.8	38.6	0.10	0.31
6.0-7.0	1114.6	13.8	52.4	0.11	0.42
7.0-8.0	1109.9	15.9	68.3	0.13	0.55
8.0-9.0	1104.2	17.9	86.2	0.15	0.70
9.0-10.0	1099.0	19.9	106.1	0.16	0.86
10.0-11.0	1095.8	21.9	128.0	0.18	1.04
11.0-12.0	1095.7	24.0	151.9	0.19	1.23
12.0-13.0	1098.7	26.1	178.0	0.21	1.44
13.0-14.0	1103.3	28.2	206.3	0.23	1.67
14.0-15.0	1108.3	30.4	236.7	0.25	1.92
15.0-16.0	1111.8	32.6	269.3	0.26	2.18
16.0-17.0	1117.3	34.8	304.1	0.28	2.47
17.0-18.0	1124.3	37.1	341.1	0.30	2.77
18.0-19.0	1131.9	39.4	380.5	0.32	3.09
19.0-20.0	1142.5	41.8	422.3	0.34	3.43
20.0-21.0	1152.8	44.3	466.6	0.36	3.78
21.0-22.0	1164.1	46.8	513.4	0.38	4.16
22.0-23.0	1176.9	49.4	562.8	0.40	4.56
23.0-24.0	1189.7	52.0	614.8	0.42	4.99
24.0-25.0	1200.4	54.6	669.4	0.44	5.43
25.0-26.0	1208.9	57.1	726.5	0.46	5.89
26.0-27.0	1215.0	59.5	785.9	0.48	6.37
27.0-28.0	1219.2	61.7	847.7	0.50	6.87
28.0-29.0	1221.9	63.9	911.6	0.52	7.39
29.0-30.0	1222.3	66.0	977.6	0.54	7.93
30.0-31.0	1222.7	68.1	1045.7	0.55	8.48
31.0-32.0	1224.7	70.2	1115.8	0.57	9.05
32.0-33.0	1231.3	72.6	1188.4	0.59	9.64
33.0-34.0	1245.9	75.4	1263.8	0.61	10.25
34.0-35.0	1264.4	78.5	1342.3	0.64	10.89
35.0-36.0	1280.6	81.5	1423.9	0.66	11.55

C Plane (°):0.0-360.0: 45.0
 Test Lab:
 Test Type: TYPE C
 Temperature:
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: GPM-1800B
 Distance: 10.160 m
 Humidity:
 Inspector:

Zonal Lumen (Continue 1)

Gamma [°]	Imean [cd]	Zonal Flux [lm]	Sum Zonal Flux [lm]	Rel Zonal Flux [%]	Sum Rel Zonal Flux [%]
36.0-37.0	1294.2	84.4	1508.3	0.68	12.23
37.0-38.0	1306.7	87.2	1595.5	0.71	12.94
38.0-39.0	1319.0	90.0	1685.6	0.73	13.67
39.0-40.0	1333.1	93.0	1778.6	0.75	14.42
40.0-41.0	1350.4	96.2	1874.7	0.78	15.20
41.0-42.0	1368.6	99.4	1974.2	0.81	16.01
42.0-43.0	1384.3	102.6	2076.7	0.83	16.84
43.0-44.0	1394.8	105.3	2182.0	0.85	17.70
44.0-45.0	1396.3	107.3	2289.3	0.87	18.57
45.0-46.0	1387.6	108.5	2397.9	0.88	19.45
46.0-47.0	1374.5	109.3	2507.2	0.89	20.33
47.0-48.0	1362.5	110.2	2617.4	0.89	21.23
48.0-49.0	1352.1	111.0	2728.4	0.90	22.13
49.0-50.0	1344.5	112.1	2840.5	0.91	23.04
50.0-51.0	1340.6	113.4	2954.0	0.92	23.96
51.0-52.0	1338.1	114.8	3068.8	0.93	24.89
52.0-53.0	1337.6	116.4	3185.2	0.94	25.83
53.0-54.0	1341.0	118.2	3303.4	0.96	26.79
54.0-55.0	1345.0	120.1	3423.5	0.97	27.76
55.0-56.0	1346.5	121.7	3545.2	0.99	28.75
56.0-57.0	1345.2	123.0	3668.2	1.00	29.75
57.0-58.0	1341.7	124.1	3792.3	1.01	30.75
58.0-59.0	1333.6	124.7	3917.0	1.01	31.76
59.0-60.0	1319.3	124.7	4041.6	1.01	32.78
60.0-61.0	1297.8	123.9	4165.5	1.00	33.78
61.0-62.0	1269.9	122.4	4287.9	0.99	34.77
62.0-63.0	1240.1	120.6	4408.5	0.98	35.75
63.0-64.0	1210.8	118.8	4527.3	0.96	36.71
64.0-65.0	1183.0	117.1	4644.4	0.95	37.66
65.0-66.0	1159.6	115.7	4760.1	0.94	38.60
66.0-67.0	1142.5	114.9	4875.0	0.93	39.53
67.0-68.0	1131.7	114.7	4989.7	0.93	40.46
68.0-69.0	1131.4	115.4	5105.1	0.94	41.40
69.0-70.0	1138.6	116.9	5222.1	0.95	42.35
70.0-71.0	1150.3	118.9	5341.0	0.96	43.31
71.0-72.0	1164.5	121.1	5462.1	0.98	44.29

C Plane (°):0.0-360.0: 45.0
 Test Lab:
 Test Type: TYPE C
 Temperature:
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: GPM-1800B
 Distance: 10.160 m
 Humidity:
 Inspector:

Zonal Lumen (Continue 2)

Gamma [°]	Imean [cd]	Zonal Flux [lm]	Sum Zonal Flux [lm]	Rel Zonal Flux [%]	Sum Rel Zonal Flux [%]
72.0-73.0	1175.5	122.9	5585.0	1.00	45.29
73.0-74.0	1182.8	124.4	5709.4	1.01	46.30
74.0-75.0	1188.6	125.6	5835.0	1.02	47.32
75.0-76.0	1193.5	126.7	5961.7	1.03	48.35
76.0-77.0	1195.5	127.5	6089.2	1.03	49.38
77.0-78.0	1192.7	127.7	6216.9	1.04	50.42
78.0-79.0	1182.1	127.0	6343.9	1.03	51.45
79.0-80.0	1162.2	125.3	6469.2	1.02	52.46
80.0-81.0	1133.2	122.6	6591.8	0.99	53.46
81.0-82.0	1096.7	118.9	6710.7	0.96	54.42
82.0-83.0	1056.3	114.8	6825.5	0.93	55.35
83.0-84.0	1014.7	110.6	6936.1	0.90	56.25
84.0-85.0	977.2	106.7	7042.8	0.87	57.11
85.0-86.0	949.6	103.8	7146.6	0.84	57.96
86.0-87.0	935.0	102.3	7248.9	0.83	58.79
87.0-88.0	935.9	102.5	7351.4	0.83	59.62
88.0-89.0	952.8	104.4	7455.9	0.85	60.46
89.0-90.0	983.1	107.8	7563.7	0.87	61.34
90.0-91.0	1020.3	111.9	7675.6	0.91	62.25
91.0-92.0	1056.8	115.9	7791.4	0.94	63.18
92.0-93.0	1087.3	119.1	7910.6	0.97	64.15
93.0-94.0	1109.2	121.4	8032.0	0.98	65.14
94.0-95.0	1122.1	122.7	8154.6	0.99	66.13
95.0-96.0	1127.5	123.1	8277.7	1.00	67.13
96.0-97.0	1126.9	122.8	8400.5	1.00	68.12
97.0-98.0	1120.2	121.8	8522.3	0.99	69.11
98.0-99.0	1107.2	120.1	8642.4	0.97	70.09
99.0-100.0	1088.5	117.7	8760.1	0.95	71.04
100.0-101.0	1064.7	114.8	8874.9	0.93	71.97
101.0-102.0	1037.9	111.5	8986.4	0.90	72.88
102.0-103.0	1010.3	108.2	9094.6	0.88	73.75
103.0-104.0	984.4	105.0	9199.6	0.85	74.60
104.0-105.0	962.5	102.2	9301.8	0.83	75.43
105.0-106.0	945.3	99.9	9401.6	0.81	76.24
106.0-107.0	934.5	98.3	9499.9	0.80	77.04
107.0-108.0	930.6	97.3	9597.2	0.79	77.83

C Plane (°):0.0-360.0: 45.0
 Test Lab:
 Test Type: TYPE C
 Temperature:
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: GPM-1800B
 Distance: 10.160 m
 Humidity:
 Inspector:

Zonal Lumen (Continue 3)

Gamma [°]	I _{mean} [cd]	Zonal Flux [lm]	Sum Zonal Flux [lm]	Rel Zonal Flux [%]	Sum Rel Zonal Flux [%]
108.0-109.0	933.0	97.0	9694.3	0.79	78.62
109.0-110.0	940.4	97.2	9791.5	0.79	79.40
110.0-111.0	949.9	97.6	9889.0	0.79	80.20
111.0-112.0	958.5	97.8	9986.8	0.79	80.99
112.0-113.0	965.1	97.8	10084.6	0.79	81.78
113.0-114.0	969.2	97.5	10182.1	0.79	82.57
114.0-115.0	969.7	96.8	10278.8	0.78	83.36
115.0-116.0	965.4	95.6	10374.4	0.77	84.13
116.0-117.0	955.6	93.8	10468.2	0.76	84.89
117.0-118.0	940.3	91.5	10559.7	0.74	85.63
118.0-119.0	920.4	88.7	10648.4	0.72	86.35
119.0-120.0	896.5	85.6	10733.9	0.69	87.05
120.0-121.0	870.5	82.3	10816.2	0.67	87.71
121.0-122.0	844.3	78.9	10895.1	0.64	88.35
122.0-123.0	819.5	75.8	10970.9	0.61	88.97
123.0-124.0	797.8	73.0	11043.9	0.59	89.56
124.0-125.0	780.0	70.5	11114.3	0.57	90.13
125.0-126.0	766.8	68.5	11182.8	0.56	90.69
126.0-127.0	758.6	66.9	11249.7	0.54	91.23
127.0-128.0	752.9	65.5	11315.2	0.53	91.76
128.0-129.0	746.0	64.0	11379.2	0.52	92.28
129.0-130.0	736.5	62.3	11441.5	0.51	92.79
130.0-131.0	723.8	60.4	11501.9	0.49	93.27
131.0-132.0	707.0	58.1	11559.9	0.47	93.75
132.0-133.0	685.9	55.5	11615.4	0.45	94.20
133.0-134.0	662.2	52.7	11668.1	0.43	94.62
134.0-135.0	637.9	49.9	11718.0	0.40	95.03
135.0-136.0	612.8	47.1	11765.1	0.38	95.41
136.0-137.0	586.6	44.3	11809.3	0.36	95.77
137.0-138.0	561.8	41.6	11851.0	0.34	96.11
138.0-139.0	542.9	39.4	11890.4	0.32	96.43
139.0-140.0	528.1	37.6	11928.0	0.30	96.73
140.0-141.0	511.4	35.7	11963.7	0.29	97.02
141.0-142.0	493.3	33.7	11997.4	0.27	97.29
142.0-143.0	476.7	31.8	12029.2	0.26	97.55
143.0-144.0	459.7	30.0	12059.2	0.24	97.79

C Plane (°):0.0-360.0: 45.0
 Test Lab:
 Test Type: TYPE C
 Temperature:
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: GPM-1800B
 Distance: 10.160 m
 Humidity:
 Inspector:

Zonal Lumen (Continue 4)

Gamma [°]	I _{mean} [cd]	Zonal Flux [lm]	Sum Zonal Flux [lm]	Rel Zonal Flux [%]	Sum Rel Zonal Flux [%]
144.0-145.0	437.1	27.8	12087.0	0.23	98.02
145.0-146.0	411.6	25.6	12112.6	0.21	98.23
146.0-147.0	389.8	23.6	12136.2	0.19	98.42
147.0-148.0	370.6	21.8	12158.0	0.18	98.60
148.0-149.0	351.4	20.1	12178.1	0.16	98.76
149.0-150.0	334.0	18.6	12196.7	0.15	98.91
150.0-151.0	318.0	17.2	12213.9	0.14	99.05
151.0-152.0	299.3	15.7	12229.6	0.13	99.18
152.0-153.0	277.6	14.1	12243.6	0.11	99.29
153.0-154.0	255.8	12.5	12256.1	0.10	99.39
154.0-155.0	236.4	11.2	12267.3	0.09	99.48
155.0-156.0	217.0	9.9	12277.2	0.08	99.56
156.0-157.0	198.3	8.7	12285.8	0.07	99.63
157.0-158.0	180.9	7.6	12293.4	0.06	99.69
158.0-159.0	162.1	6.5	12299.9	0.05	99.75
159.0-160.0	145.2	5.6	12305.5	0.05	99.79
160.0-161.0	129.6	4.7	12310.3	0.04	99.83
161.0-162.0	113.8	4.0	12314.2	0.03	99.86
162.0-163.0	100.5	3.3	12317.5	0.03	99.89
163.0-164.0	88.3	2.8	12320.3	0.02	99.91
164.0-165.0	77.3	2.3	12322.6	0.02	99.93
165.0-166.0	67.7	1.9	12324.4	0.02	99.95
166.0-167.0	58.2	1.5	12325.9	0.01	99.96
167.0-168.0	50.6	1.2	12327.1	0.01	99.97
168.0-169.0	44.9	1.0	12328.1	0.01	99.98
169.0-170.0	40.3	0.8	12328.9	0.01	99.98
170.0-171.0	35.5	0.6	12329.5	0.01	99.99
171.0-172.0	30.6	0.5	12330.0	0.00	99.99
172.0-173.0	26.4	0.4	12330.4	0.00	99.99
173.0-174.0	22.1	0.3	12330.7	0.00	100.00
174.0-175.0	17.8	0.2	12330.9	0.00	100.00
175.0-176.0	14.0	0.1	12331.0	0.00	100.00
176.0-177.0	11.5	0.1	12331.1	0.00	100.00
177.0-178.0	10.2	0.0	12331.1	0.00	100.00
178.0-179.0	9.9	0.0	12331.1	0.00	100.00
179.0-180.0	9.9	0.0	12331.2	0.00	100.00

C Plane (°):0.0-360.0: 45.0
 Test Lab:
 Test Type: TYPE C
 Temperature:
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: GPM-1800B
 Distance: 10.160 m
 Humidity:
 Inspector: